


WATERLINE RELOCATION &
CONCRETE ENCASUREMENT DETAIL

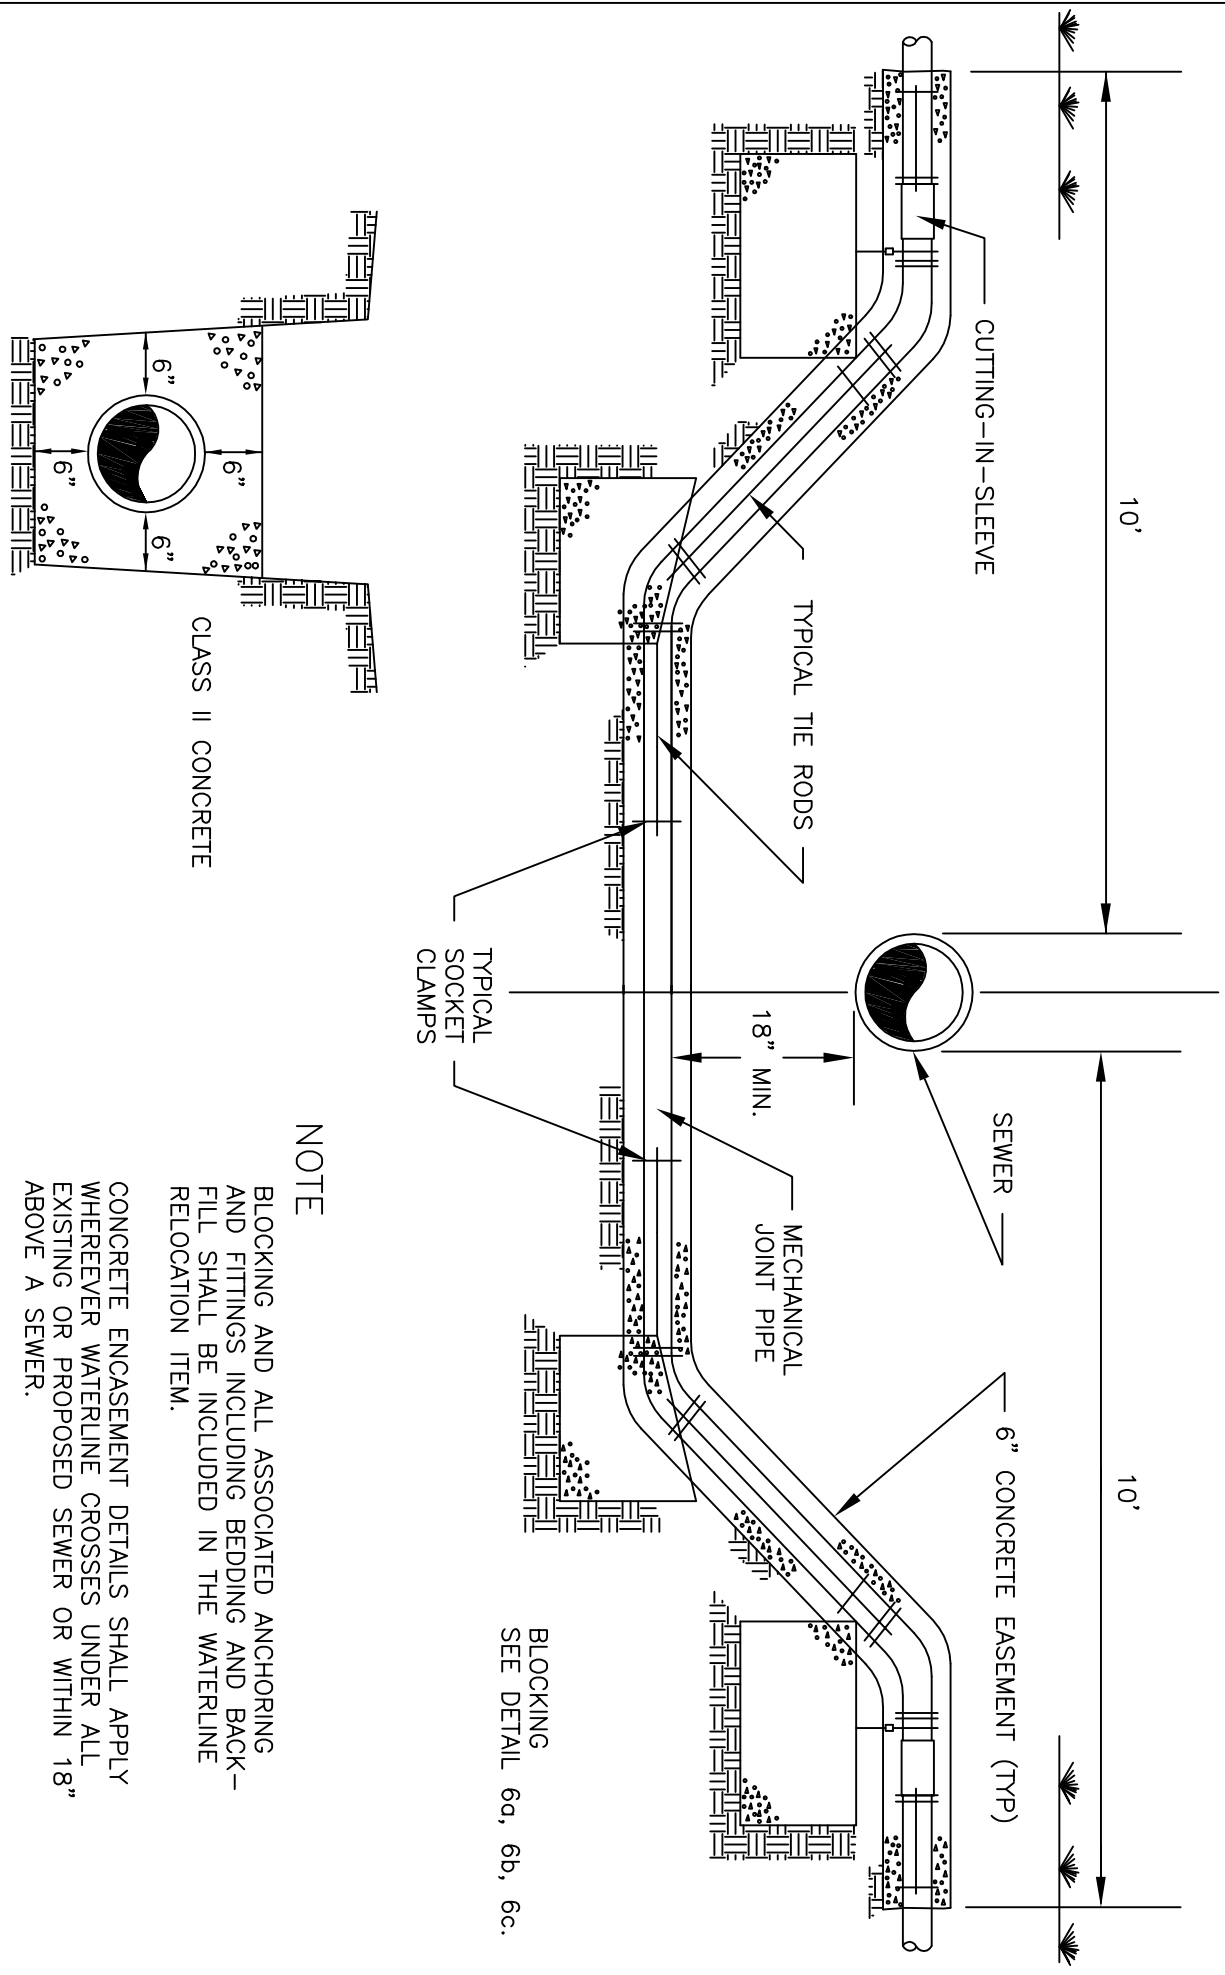

BLOCKING
SEE DETAIL 6a, 6b, 6c.

NOTE

BLOCKING AND ALL ASSOCIATED ANCHORING AND FITTINGS INCLUDING BEDDING AND BACK-FILL SHALL BE INCLUDED IN THE WATERLINE RELOCATION ITEM.

CONCRETE ENCASUREMENT DETAILS SHALL APPLY WHEREVER WATERLINE CROSSES UNDER ALL EXISTING OR PROPOSED SEWER OR WITHIN 18" ABOVE A SEWER.

CLASS II CONCRETE

STANDARD DRAWING NO. 8
CITY OF BOWLING GREEN
AUGUST 1990